

Solar Magazine

Solar-Reports:

- ▶ [Solar-assisted heating and cooling of buildings: technology, markets and perspectives](#)
- ▶ [United States PV market becomes a global demand leader by 2012](#)
- ▶ [Third generation thin film solar photovoltaic technologies on track to breakthrough](#)
- ▶ [Concentrating Solar Power \(CSP\): Outlook on Large Potentials and the MENA Region](#)
- ▶ [The Price of Policy Risk – Empirical Study Looks at the Willingness of European Photovoltaic Project Developers to Invest](#)
- ▶ [Photovoltaics: Thin-film technology about to make its breakthrough: crystalline silicon cells to continue their dominant role](#)

THE SOURCE OF POWER >>

Solar-assisted heating and cooling of buildings: technology, markets and perspectives

by Björn Nienborg
2010-02-09

Even if the future still holds a few hurdles that will have to be overcome, developments in the field of solar-assisted heating and cooling show that solar air-conditioning is moving ahead. Thermal cooling has the further potential of increasing the utilisation of combined heat and power units (CHP). Another field of application that is currently being analysed is that of connecting to remote heating grids since these are often not fully utilised during summer. In the February 2010 Solar Report Björn Nienborg, scientist at the Fraunhofer Institute for Solar Energy Systems ISE in Freiburg, provides an overview of the future perspectives of air-conditioning with solar heat in anticipation of the upcoming summer. But also in the extremely cold winter 2009 these contents may be of relevance, since the operation of a chiller as heat pump in winter can further increase the degree of utilisation of a solar heat system and its economic viability.

Solar-Report as [PDF-Document](#)



Photos: Single-family residential house in Alzenau, Germany. Chiller: Sortech ACS08. Source of power: 24 m² of flat solar heat panels. Heat rejection: dry reverse cooler with fresh water spraying system (RCS 08). Cooling: cold distribution through a central ventilation system with ceiling fans (fresh air cooling and recirculation). Planning & implementation: SolarNext AG / Rimsting (Germany)

Growing energy demand for air-conditioning of buildings

Approximately 40% of energy consumption in Europe is utilised in buildings, just over half of this being consumed in private households [1]. The area-specific energy consumption for heating decreased over the last 20 years as a result of increased energy efficiency in the

- ▶ [Solar Report](#)
- ▶ [Solar News](#)
- ▶ [Solar Links](#)
- ▶ [Solar Energy System of the Month](#)
- ▶ [Solar point of view](#)
- ▶ [Solar Interviews](#)
- ▶ [Solar Archive:](#)
 - ▶ [Photovoltaics](#)
 - ▶ [Solar heating](#)
 - ▶ [Solar Building](#)
 - ▶ [Fuel Cell](#)
 - ▶ [Solar News Archive](#)

- ▶ [Your Suggestion](#)



provision of heating as well as modern construction methods, but consumption for air-conditioning of buildings is strongly increasing. The reasons for this are the increased thermal loads in buildings caused by electrical devices, the increased expectations of comfort regarding the ambient climate, as well as the architectural trend to utilise more large light-transmissive surfaces. By 2020 it is anticipated that the number of electrical climate-controlling devices installed in European residential houses will increase annually by over 10% [2].

Air-conditioning with solar heat and solar power

On the basis of solar radiation and air-conditioning demand peaking at the same time, it is sensible to resort to solar cooling and thus to cover a considerable portion of the load with low emissions. In practice the following processes are applied:

- ▶ Solar collectors convert solar radiation to heat that is then fed into a thermally driven cooling process or into a direct air-conditioning process;
- ▶ Particularly in special applications, for example for cooling medication in remote areas that are not connected to the grid, a photovoltaic generator transforms solar radiation to solar power that then drives a refrigeration process – usually in the form of a compression chiller.

For cooling and climatising of buildings, only solar-*thermally* driven processes are used – this edition of the Solar Report will focus on these.



Photo: Climatisation of a building of the University of Sevilla. Chiller: Double-stage BROAD BZH 15 IX, China. Source of power: 352 m² linear-concentrated Fresnel collectors (Mirrox, Germany). Heat rejection: Cooling tower. Cooling: cold distribution through a central ventilation system. Photo source: Mirrox GmbH.

Solar thermics save electricity and avoid CO₂ emissions

In comparison to conventional, electrically driven compression cooling technology, solar cooling boasts a number of advantages. The machines generally utilise environmentally friendly refrigerants. In most cases water is utilised which, compared to refrigerants used in compression cooling machines, has no greenhouse potential (e.g. R134a: GWP=1300). Because the systems merely require auxiliary energy for the operation of pumps, heat rejection, etc. they utilise significantly less power if designed correctly. Thus, besides the resulting CO₂ savings, the electricity grid is also relieved – in some southern countries this constitutes a significant advantage, since the mass operation of electrical air-conditioners in summer occasionally leads to severe strain on the electricity grid. In addition to cooling, the

PROINSO

IMMEDIATE AVAILABILITY!



SECURE YOUR PROJECT



11000 TL

+



230 Wp Poly

BOOK YOUR MODULES AND INVERTERS NOW

www.proinso.net
Ads by Google

solar collector system can also provide thermal energy for domestic hot water preparation and heating support which leads to a further reduction of emissions. Furthermore, noise emissions are significantly lower since the machines work without compressors.

Thermally driven chillers

The thermally driven cooling and air-conditioning process is at the heart of every solar cooling system. Thermally driven air-conditioning and cooling processes available on the market have in common that they utilise sorption processes. A liquid or a gaseous substance either accumulates on the surface of a solid, porous substance (adsorption) or is taken up by a liquid or a solid substance (absorption). In some processes supply air is directly conditioned, i.e. treated in terms of temperature and humidity. Since this air is generally external air that is not recirculated, this process is referred to as open cycle. In a closed cycle, however, water that circulates in a closed hydraulic circuit is cooled.

Research is currently developing further technologies, e.g. steam jet chilling or thermally driven compressors, which will not be further discussed at this point.

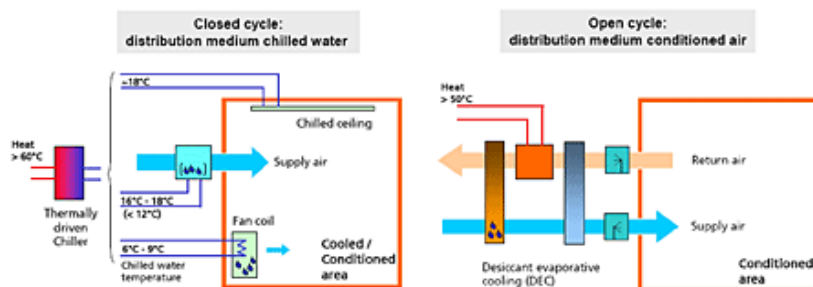


Image 1: Comparison of open-cycle and closed-cycle cooling systems;
Source: Fraunhofer ISE

Open processes for buildings with high moisture loads and high air exchange rates

In the DEC-processes outside air is dehumidified through sorption and is then brought to the desired temperature by heat recovery as well as direct and indirect evaporative cooling. Usually dehumidifying is achieved in a rotor containing the desiccant material silica gel or lithium chloride, but increasingly processes of liquid desiccants (desiccant material: lithium chloride) are becoming the focus of attention. Various companies are already offering this technology. In these systems the solar heat is required for the regeneration of the absorption/adsorption unit.

The use of open-cycle systems is promising in buildings with high humidity loads and high air exchange rates. The installation of ducts for the supply air and the return air, as well as a heat recovery unit is required. In principle, the process can be combined with chilling water in a closed-cycle system (e.g. in order to remove sensitive loads from rooms through, for example, chilled ceilings).

Closed-cycle systems for chilling water

Closed-cycle desiccant evaporative cooling systems are based on the following desiccant processes:

- ▶ adsorption: which works on the basis of solid desiccants. Customary material pairs are silica gel or zeolith as desiccant and water as refrigerant.
- ▶ absorption: here the desiccants are liquid. Commercially available machines utilise the material pairs of lithium bromide as desiccant and water as refrigerant, or water as desiccant and ammonium as refrigerant. With the latter material pair, temperatures of below 0°C can be achieved.

More information on closed-cycle and open-cycle processes can be found, for example, under [3], as well as in the directive on solar climatisation [6]. In the following we will be focussing on the systems for water chilling, i.e. on closed-system processes.



pv-tech.org

Lowering the system and operating costs by increasing the COP

The efficiency of thermal chillers is determined by the Coefficient of Performance (COP). Analogous to the energy efficiency ratio (EER) of electrical compression chillers it is defined by the ratio of output to input, i.e. of supplied cold compared to the required heat. Typical values for single-stage machines range between 0.5 and 0.8. These values, however, cannot be compared to those achieved by compression chillers, since these are electrically powered. The COP strongly depends on the hot water inlet temperature, the required temperature of the chilled water and the temperature of the cooling water. An increase of the COP, which can be achieved through more efficient technologies or technical measures on the operational side (e.g. through higher chilled water temperatures), leads to a decreased demand for solar driving heat and thus also to a decreased demand for heat rejection. This has a positive effect on system and operating costs.

The technologies described have already been used for many years in the field of large-scale cooling (>100kW), thus numerous manufacturers are operating in the field. Small-scale machines (<20kW) have only recently become available on the market. Table 1 provides an overview of the nominal operating data. When making a product choice, it is essential that the boundary conditions be taken into consideration and that the respective data be requested from other manufacturers when required.

Table 1: Overview of market available chillers with a nominal chilling capacity of < 20kW

Manufacturer	Yazaki	EAW	Sortech	Pink
Designation	WFC-SC5	Wegracal SE 15	ACS15	chillii PSC12
Technology	Absorption	Absorption	Adsorption	Absorption
Sorbent refrigerant	LiBr/H ₂ O	LiBr/H ₂ O	Silikagel/H ₂ O	H ₂ O/NH ₃
Chilling capacity [kW]	17.5	15	15	12
COP	0,7	0.71	0.6	0.63
Hot-water temperature	88/83°C	90/80°C	72/65°C	75/68°C
Cooling water temperature	31/35°C	30/35°C	27/32°C	24/29°C
Chilled water temperature	12.5/7°C	17/11°C	18/15°C	18/15°C
Electricity demand	48W (max. 72)	300W	14W	300W
Special characteristics			- WP-mode1	

Tabelle 1 (continuance): see above

Manufacturer	ClimateWell	Invensor	Sortech	Invensor
Designation	ClimateWell SolarChiller	HTC 10	ACS08	LTC 07
Technology	Absorption	Adsorption	Adsorption	Adsorption
Sorbent refrigerant	LiCl/H ₂ O	Zeolith/H ₂ O	Silikagel/H ₂ O	Zeolith/H ₂ O
Chilling capacity [kW]	n/a	10	8	7
COP	n/a	0,5	0,6	0,54
Hot-water temperature	n/a	85/77°C	72/65°C	65/59,5°C
Cooling water temperature	n/a	27/33°C	27/32°C	27/31°C
Chilled water temperature	n/a	18/15°C	18/15°C	18/15°C

Electricity demand	18W	20W	7W	20W
Special characteristics	-Internal chem. storage unit		- WP-mode 1	
	- WP-mode1			

This list is not exhaustive.

1 WP= heat pump

Structure of solar cooling systems

The fundamental functioning of a solar cooling system is presented in Image 3. The collector field transforms solar radiation into heat with which the storage unit is then charged. Upon demand the storage then supplies 'consumers' with energy: the thermally driven chiller for cooling, the heating system as well as the domestic hot water system. If solar heat is insufficient (e.g. on cloudy days, during winter) a conventional water heater can provide heat. For the system to work efficiently it is important to select suitable components, to install and commission them adequately, and to implement a well adjusted control strategy.

Flat plate or vacuum tube collectors for different cooling processes

The efficiency of standard flat plate collectors rapidly decreases when temperatures increase. Thus they are mainly suitable for adsorption cooling machines that are reliable at relatively low temperatures (from 65°C). All other cooling processes generally require input temperatures of above 75°C. These can be provided either by improved flat plate collectors (with anti-reflective coating and/or double glass cover) or by vacuum tube collectors. Generally, 3 to 5 square metres of collector surface are installed for every kilowatt of chilling capacity [3]. This surface area was determined as a compromise between solar coverage on the one hand and a limitation of investment costs and minimisation of stagnation risk on the other hand. However, the exact size of a collector depends on its location as well as the load profiles of its application and would thus form part of system planning.

Partially contradictory requirements for storage units

The storage unit is the central interface of the system and must at times fulfil contradictory requirements. During the cooling season it shall quickly provide the starting temperature of the chiller, therefore a small volume is favorable. However, in order to ensure continuous operation even if clouds move by, large capacities are required – as well as for heating support in winter. In addition it is to assure a stable temperature stratification regardless of high volume flows. Practice has shown that sizes of about 50 litres per square metre of installed collector surface are practicable.

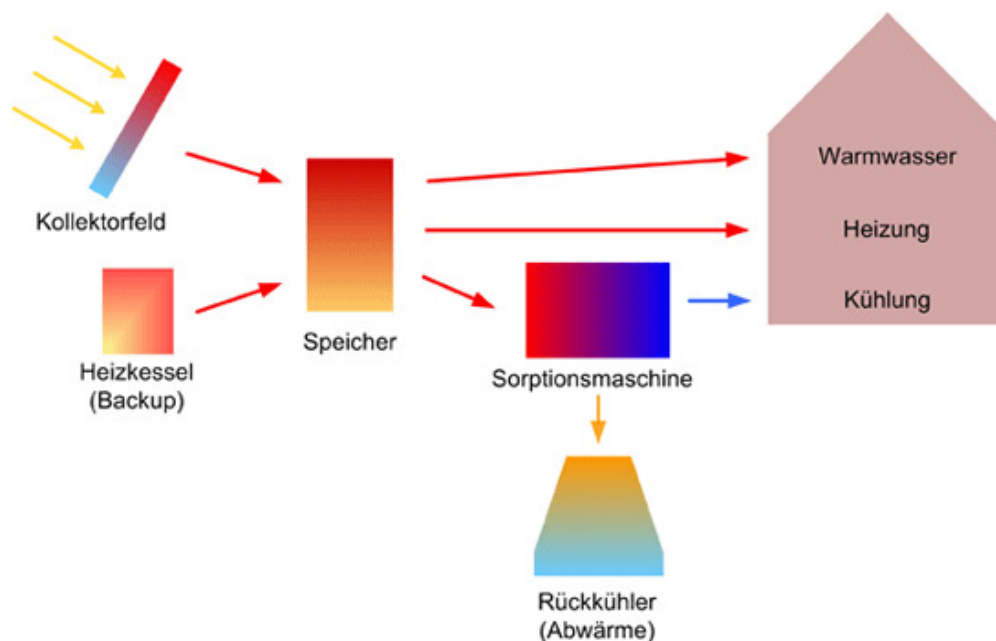


Image 3: Schematic presentation of the structure of a solar cooling system; Source: Fraunhofer ISE. Wording: Kollektorfeld: Solar thermal collectors; Heizkessel: Boiler; Speicher: Storage unit; Sorptionsmaschine: Sorption chiller; Rückkühler: Heat rejection; Warmwasser: Domestic hot water; Heizung: Heating; Kühlung: Cooling

Hybrid coolers or dry coolers with fresh water spraying systems combine the advantages of liquid and dry cooling

Heat rejection greatly affects the performance and efficiency of the chiller. In most systems the waste heat is released into the environment by dry coolers or wet cooling towers. The former are suitable for moderate climate zones that only occasionally have high outside temperatures ($>30^{\circ}\text{C}$). Wet cooling towers have the advantage that cooling water temperatures below ambient temperature can be obtained. However, it only works if the relative high humidity allows for evaporative cooling. In regions with a shortage of water it is also unsuitable. In addition, some countries have imposed strict hygiene regulations on wet cooling towers which make the operation of small systems economically unviable. Hybrid coolers or dry coolers with fresh water spraying systems combine the advantages of both technologies. All four technologies have in common that the ventilator constitutes an important part in the auxiliary energy demand of the system. Thus it is recommended to utilise efficient EC motors. To further reduce electricity consumption, these should be controlled according to operating conditions and cooling demand. Depending on the respective local conditions waste heat can also be rejected in other ways, e.g. through boreholes, swimming pools or ground water. Ideally the heat can be used in other places.

In the cold-water circuit of the cooling machine, high temperatures improve performance. Thus thermo active building systems and chilled ceilings are particularly suitable for cold distribution. When fan coils are used, they can usually be operated with higher temperatures than the $7/12^{\circ}\text{C}$ spread used in conventional HVAC systems. For this purpose convectors would have to be of larger dimensions.

In order to keep the use of electrical auxiliary energy for pumps at a minimum, tube sections in all hydraulic circuits must adhere

to manufacturers' specifications. It is also recommended that high-effic

iciency pumps be used.

When selecting components, their interaction as well as the cooling application must be considered. Furthermore, it is essential to be aware of the fact that boundary conditions other than the nominal conditions, can negatively affect the performance of the cooling machine. If the system is not designed for the nominal operation point, the relevant operating data must be requested from the manufacturer. Then, for example, a dry reverse cycle chiller can also be used in warm climates if the solar thermal system is adapted accordingly.



Photos: Single-family residential home in Chiclana de la Frontera, Spain. Cooling machine: ClimateWell 10. Source of power: 36 m² flat plate collectors. Heat rejection: swimming pool. Cooling: Distribution through chilled floors. Planning & implementation: "8'17".



Load profile is essential for efficient solar cooling, additional benefits through the heating of water or heating support

The decision whether solar cooling is sensible at all is influenced strongly by the load profile. Solar irradiation and cooling demand must be correlated, since the use of fossil fuels for the operation of the chiller is disadvantageous from a primary energy point of view and should be avoided. In order to achieve the highest possible degree of utilisation, applications that also require heat for heating water or for the heating system outside the cooling season are recommended. Thus residential buildings and small office buildings are most suitable. If cooling is required throughout the entire year (process cold, server rooms) the solar cooling system can be used merely as a fuel-saver for conventional air-conditioning. In such a case free cooling directly through the heat rejection unit might be an option in the cooler seasons.

Market situation

So far as to the technological side – but what is the market potential like? In attempting to find an answer to this question, a SWOT analysis (Strengths, Weaknesses, Opportunities and Threats) was conducted within the frame of the EU project "SolarCombi+". In this study the position of solar cooling was investigated under technical, financial, market-related and legislative aspects [4].



Image 4: Current and potential future position of SolarCombi+ systems in terms of the SWOT analysis; Source: SolarCombi+

Market introduction programme should compensate high investment costs

Currently some challenges still persist: the complexity of the system technology leads to the risk of installation errors and faulty operation, the same applies to the control strategy. In addition, a lack of knowledge on the side of planners has a negative impact. Because of the complexity and the fact that hardly any standard systems have been developed, systems are usually designed individually. This results in comparably high planning costs. In addition, investment costs of between 3.200 and 5.100 Euro per kilowatt of cooling output in small systems [5] are still high. Besides the required large collector surface, chillers contribute significantly to the high prices, the reason being that they are usually manufactured only in very small series. Initial costs thus play an important role, because so far no market introduction programme that supports the complete system exists for solar cooling - opposed to the renewable electricity generation (e.g. the renewable electricity act in Germany). Furthermore, the technology is still largely unknown which causes the demand to be low.

In spite of the existing problems the future holds significant potential for solar air-conditioning. The target set at the Global Climate Conference in Copenhagen that global warming should not exceed 2°C, requires strong reductions of emissions – also in cooling, although the cooling demand is expected to rise. The increasing costs of fossil fuels further increase the relevance of lowered energy consumption and thus lower operating costs.

Manufacturers of cooling machines are aiming for mass production and pre-configured systems

Manufacturers of chillers are aiming at utilising this market opportunity. The Swedish company ClimateWell has recently erected a factory with a manufacturing capacity of up to 1 000 chillers per year in the Spanish town of Olvega. Sortech AG in Halle, Germany, is also in the process of changing to industrial series production. Furthermore, some companies are already offering preconfigured solar cooling kits (e.g. Solarnext AG, Solution Solartechnik GmbH). At the same time various companies are cooperating in national and international projects to develop and optimise such combined kit solutions. In the SolarCombi+ project an extensive simulation study was done with this objective. A database containing the results of the best configurations is available on the website of the project [6]. The low level of knowledge of such systems as well as the particularities of their structure are being addressed in specialised seminars for architects, planners and installers. In particular, the EU project SOLAIR aims at filling knowledge gaps. In addition, the website contains among many other useful information a planning guideline for solar cooling systems in different languages at no cost [7].

International Solar Heating and Cooling Programme; "GreenChiller" association in Germany

With 52 companies and institutes from 11 countries worldwide the Task 38 "Solar Air-Conditioning and Refrigeration" is the largest association of actors from the field of solar cooling [8]. In their six-monthly meetings extensive exchange of experiences in the field of planning and operation of solar cooling systems takes place. The results of these activities will be concluded in a revised edition of the "handbook for planners of solar-assisted cooling systems". Discussions are also held on strategies for and progress in the diffusion of this technology, a topic in which progress can be seen: in the German-speaking region seven companies and two research institutes have joined to form the GreenChiller e.V. association which is campaigning for political support [9]. In France, complete systems can be financed through state subsidies of up to 70% since the beginning of this year and also the costs for monitoring are covered for the first two years. In order to qualify for such subsidies, systems need to comply with various requirements, e.g. a feasibility study must forecast a specified minimum output of thermal energy [10].

References

- [1] Werner Weiss (AEE Intec), Peter Biermayr (University of Vienna): "Potential of Solar Thermal in Europe". Study within the framework of the EU project RESTMAC, 2007
- [2] Energy Efficiency of Room Air-Conditioners. DG Energy, European Commission, 1999
- [3] Hans-Martin Henning; Solar-Assisted Air-Conditioning in Buildings - A Handbook for Planners, Springer, Vienna, 2003
- [4] www.solarcombiplus.eu
- [5] Uli Jakob et al.; Effizienter Betrieb solarer Kühlsysteme mittels chillii® System Controller; Otti Solarthermie-Symposium, Bad Staffelstein, 2009
- [6] <http://wis.eurac.edu/solarcombiplus/Default.aspx> as at 18.01.2010
- [7] www.solair-project.eu/122.0.html as at 18.01.2010
- [8] www.iea-shc.org/task38/
- [9] www.greenchiller.de
- [10] <http://www.solaire-collectif.fr/index.php?pid=7> as at 18.01.2010

Additional Solar-Reports:

- ▶ [The photovoltaics industry: against all odds, strong growth continues](#)
- ▶ [PV production: The dawn of the "gigawatt" fab](#)
- ▶ [Review Intersolar 2008: the largest solar fair of the world](#)
- ▶ [2008 Photovoltaic trends: Innovative thin film technology and large-scale power plants](#)
- ▶ [Large photovoltaic power plants: average growth by almost 100 % since 2005](#)

- ▶ [Research Agenda provides a Vision for European Photovoltaic Solar Energy Technology](#)
- ▶ [Organic photovoltaics: solar power from extremely thin tinted films and polymer films](#)
- ▶ [Intersolar on its way to becoming the Solar World Fair](#)
- ▶ [Building integrated Photovoltaics \(BIPV\): Solar electric power systems conquer large roofs and façades](#)
- ▶ [Solar thermal in Europe: expanding markets, state-of-the-art technical solutions](#)
- ▶ [Photovoltaic investments outside Germany? Looking into the southern EU states](#)
- ▶ [Solar power from the desert rather than desert in Germany](#)

- ▶ [New Study: Renewable Energy can replace abandoned Nuclear Energy in Germany](#)
- ▶ [BBC Interview with Dr. Knies \(TREC\): The energy source of the future is solar](#)
- ▶ [Photovoltaic industry achieves record profits, discussion over high module prices continues](#)
- ▶ [Chinese solar modules penetrating the German market](#)
- ▶ [Solar Roof Tile Exhibition shows developments in photovoltaic roofing](#)
- ▶ [Intersolar 2006: Solar technology and demand at an all-time high](#)

- ▶ [New Photovoltaic Factories and Capacities in Germany](#)
- ▶ [Renewable Energy in Australia](#)
- ▶ [Cooling with Solar Heat: Growing Interest in Solar Air Conditioning](#)

- ▶ [Building Solar: The Prospects and Costs of Living with the Sun](#)
- ▶ [Fuel Cell Research and Development in Southern Germany](#)
- ▶ [The Photovoltaic Market in Japan: Unquestioned Leadership of World Market](#)
- ▶ [The National Energy Plan](#)
- ▶ [Trade Fair Intersolar 2001 Presents World Wide Solar Technology for the First Time](#)
- ▶ [Solar Thermal Technologies in the United States](#)
- ▶ [An Overview of Photovoltaics in the USA](#)
- ▶ [The Year 2000: Breakthrough for Solar Technology in Germany](#)

- ▶ [Fuel Cells and Solar Hydrogen-A Power Package for the Future?](#)

amazon.com
 and you're done.™

 <p>Planning and Installing Photovoltaic... Deutsche Gesellsha...</p> <p>New \$132.47</p>	 <p>Photovoltaic Systems Engineering, Th... Roger A. Messenger...</p> <p>New \$79.96</p>	 <p>Applied Photovoltaics Stuart R. Wenham, ...</p> <p>New \$38.00</p>	 <p>The Complete Idiot's Guide to Solar ... Dan Ramsey, David ...</p> <p>New \$13.57</p>	 <p>Solar Electricity Handbook 2010 Edit... Michael Boxwell</p> <p>New \$13.49</p>	 <p>Facade Construction Manual Thomas Herzog, Rol...</p> <p>New \$91.35</p>
Privacy Information					

[Banner Advertising](#) | [Bulletin Board](#) | [Events](#) | [Solar Magazine](#) | [Funding for Solar Energy](#) | [Companies](#) | [Solarstore \(G\)](#) | [Non-Profit Organizations](#) | [Lexicon](#) | [Basic Knowledge](#) | [Educational Institutions](#) | [Imprint](#) | [Contact Us](#) | [Home](#)

[up](#)

Last modified: 03/10/2010 12:30:05
[Webdesign Heindl Internet AG](#)